


# DRINKING WATER

## Carbon tetrachloride concentrations in the RWMC Well and Distribution System (1994 through 4<sup>th</sup> quarter 2004)

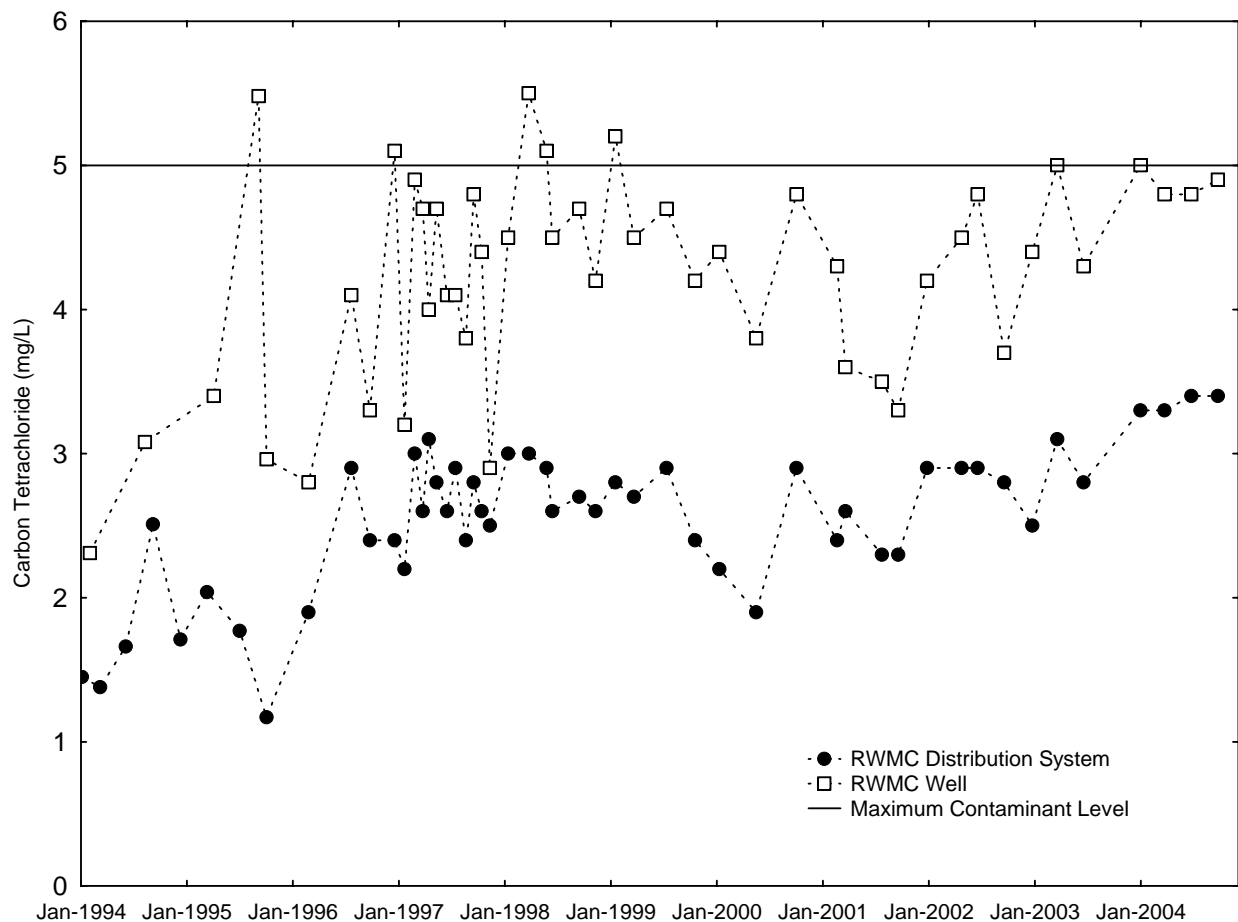

The point of compliance is the RWMC Distribution System, which has historically been below the Safe Drinking Water Act maximum contaminant level.

### FOR MORE INFORMATION

Contact: Roger Wilhelmsen  
208-526-9401  
rnw@inel.gov